


Intensity Distribution with a cutoff of -3.74

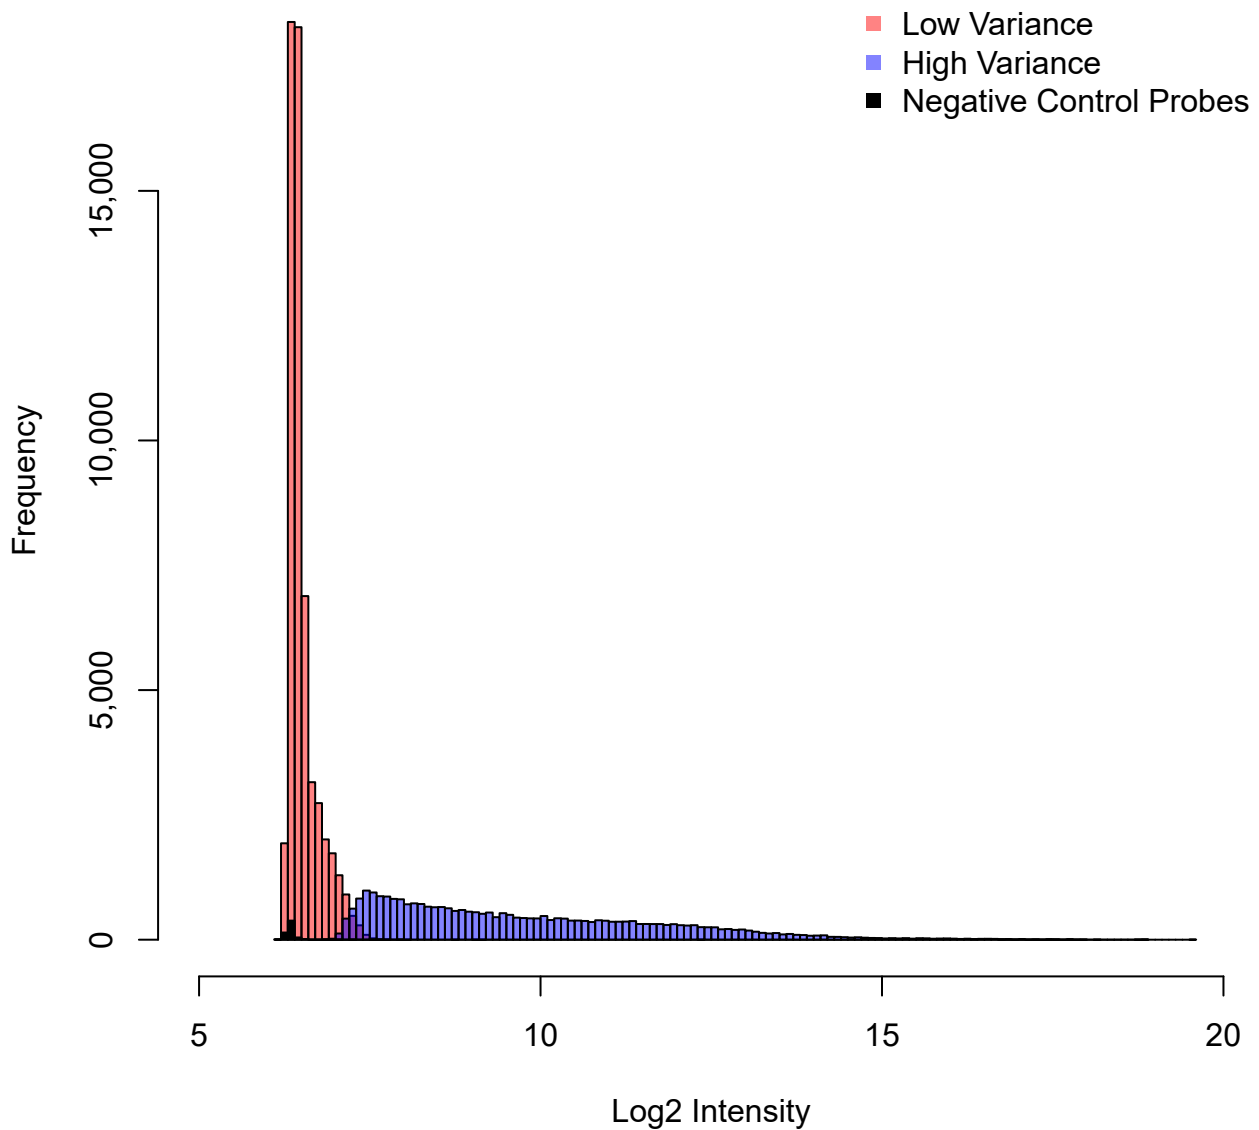

Supplemental Figure SF2

Distribution of the log₂ intensity values of probes with a log variance respectively below (low variance probes) and above (high variance probes) the cutoff of -3.74 , and of the negative control probes.